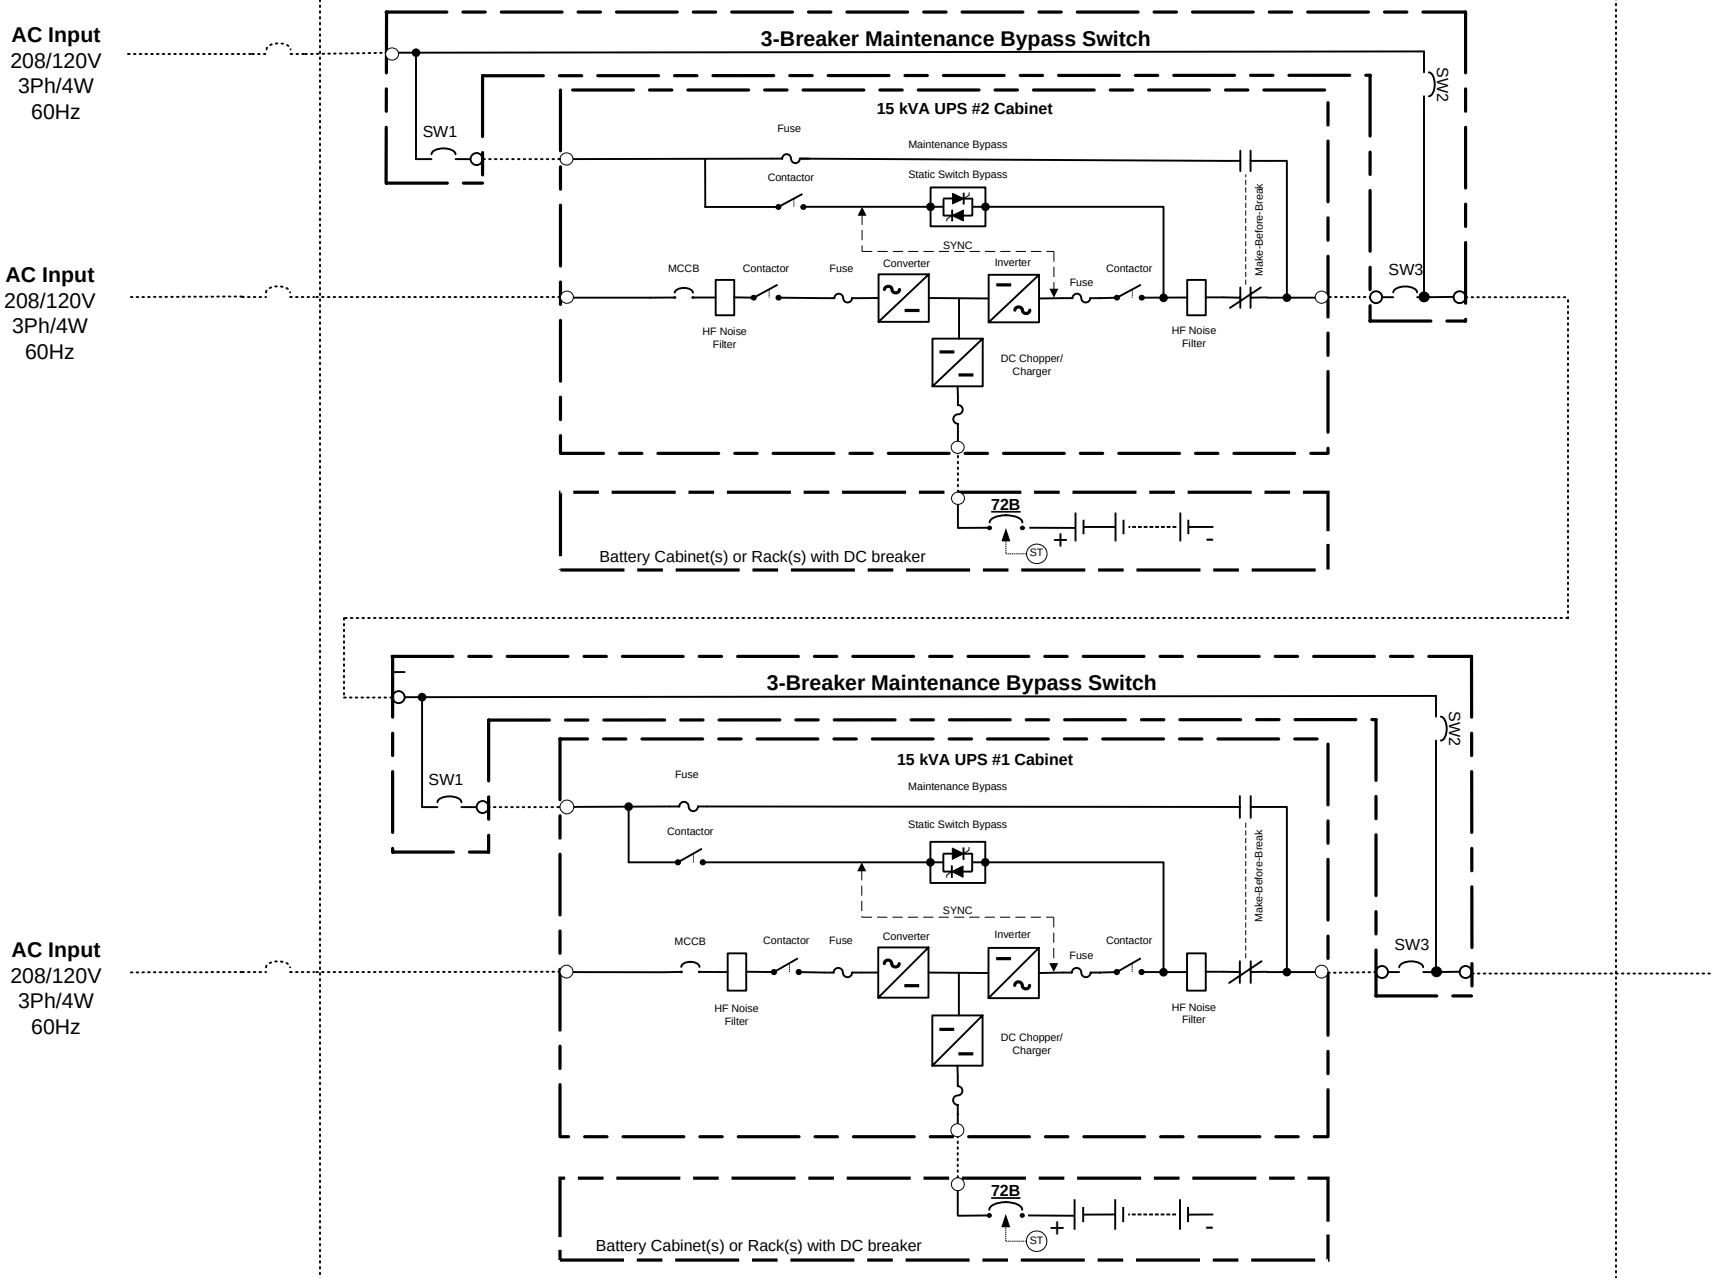

NOTES

1) This drawing is for illustration purposes only and is subject to change without notice. TIC is not responsible for any errors or omissions.

DRAWN BY
JE
DATE 08/15/05

Approved by
JIS
DATE 08/15/05

TOSHIBA
INTERNATIONAL CORPORATION
Houston Texas, USA

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF TOSHIBA INTERNATIONAL CORPORTION AND SHALL NOT BE REPRODUCED, USED, OR DISCLOSED TO OTHERS UNLESS PRIOR WRITTEN AUTHORIZATION IS OBTAINED.

TITLE
One-Line Drawing
4200***FA*** XT UPS, 15 kVA Capacity
Isolated Redundant System, Shown with
3-Breaker External Bypass Switch

DRAWING NO.
T42F3F150FAMXN

REV.
1.3